

Description


Open - Pre-stressed concrete lintels - proprietary closer

Identifier

1.23.2

NSAI modeller no.

TM/02

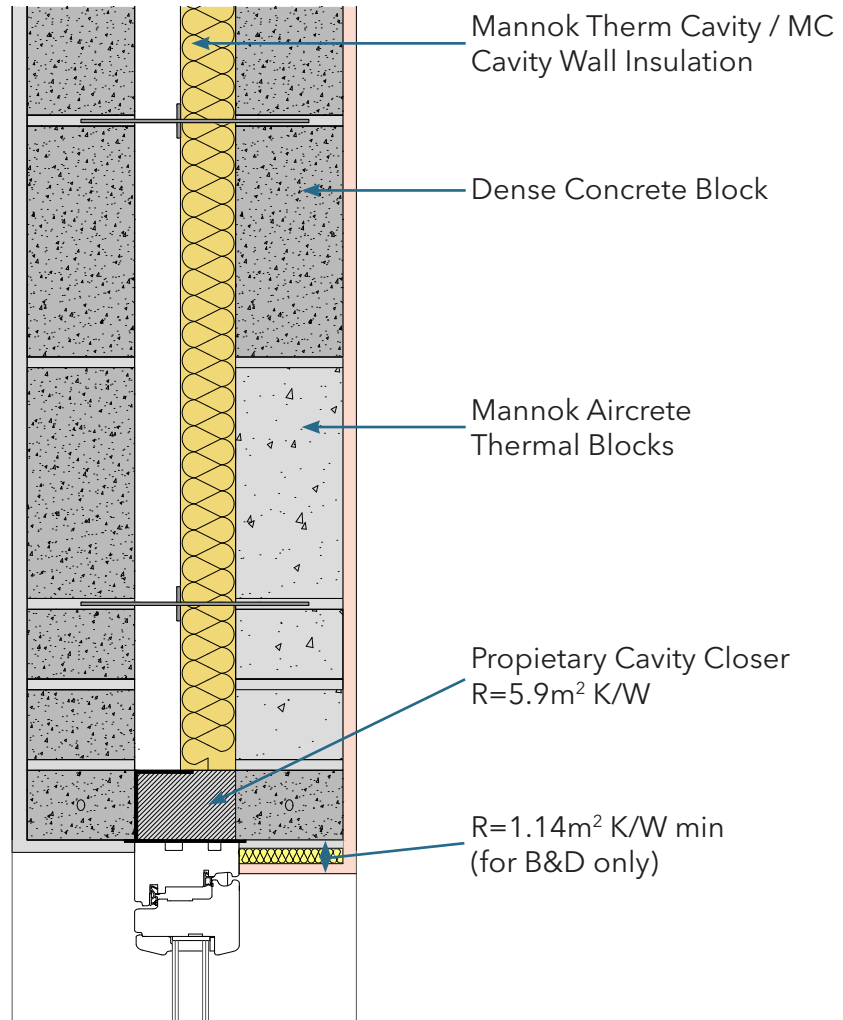

	A	B	C	D
	Wall U-value 0.21W/m ² K (partial fill insulation only) Roof = 0.16, Floor = 0.21	Wall U-value 0.15W/m ² K (partial fill insulation with internal insulation) Roof = 0.14, Floor = 0.15	Wall U-value 0.15W/m ² K (partial fill insulation only) Roof = 0.14, Floor = 0.15	Wall U-value 0.12W/m ² K (partial fill insulation with internal insulation) Roof = 0.12, Floor = 0.12

Inner leaf type	A		B		C		D	
	Ψ-value (W/mK)	Temperature factor (fRsi)	Ψ-value (W/mK)	Temperature factor (fRsi)	Ψ-value (W/mK)	Temperature factor (fRsi)	Ψ-value (W/mK)	Temperature factor (fRsi)
Mannok Aircrete Super	-0.012	0.94	-0.007	0.96	-0.004	0.95	0.002	0.96
Mannok Aircrete Standard	-0.010	0.94	-0.005	0.96	-0.003	0.95	0.003	0.96
Mannok Aircrete Seven	-0.010	0.95	-0.005	0.96	-0.002	0.95	0.003	0.96

Notes

Proprietary cavity closer with min R-value of 5.91 m²K/W.

